ISNN 3030-3907

2026/3
VOLUME 6

DEVELOPMENT OF SCIENCE

ILMIY JURNAL



Development of science

Ilmiy jurnal

2026/3 VOLUME 6

ISSN 3030 -3907

Ilmiy jurnal OAK rayosatining 2024 yil 27 sentabrdagi 361-son qaroriga asosan 02.00.00 kimyo fanlari hamda 2025 yil 12 fevral 367- son qaroriga asosan 05.00.00 texnika fanlari bo‘yicha falsafa doktori (PhD) va fan doktori (DSc) ilmiy darajasiga talabgorlarning dissertatsiya ishlari yuzasidan dissertatsiyalari asosiy ilmiy natijalarini chop etish tavsiya etilgan milliy ilmiy nashrlar ro‘yxatiga kiritilgan.

BOSH MUHARRIR:
Temirov Alisher Hoshim o‘g‘li – texnika fanlari falsafa doktori (PhD),Dotsent.
TAHRIRIYAT KENGASH RAISI:
Fozilov Sadriddin Fayzullayevich – texnika fanlari doktori, professor
TAHRIRIYAT KENGASH A’ZOLARI

TEXNIKA FANLARI/ TECHNICAL SCIENCES/ ТЕХНИЧЕСКИЕ НАУКИ

Bozorov G‘ayrat Rashidovich
Buxoro Davlat Texnika Universiteti, professor
Abdurahmonov Olim Rustamovich
Buxoro Davlat Texnika Universiteti, professor
Adizov Bobur Zamirovich
O‘zbekiston Respublikasi Fanlar akademiyasi Umumiy va noorganik kimyo instituti, professor
Hayitov Ruslan Rustamjonovich
Buxoro Davlat Texnika Universiteti, professor
Jumayev Qayum Karimovich
Buxoro Davlat Texnika Universiteti, professor.
Berdiyev Dorob Murodovich
Islom Karimov nomidagi Toshkent Davlat Texnika Universiteti, professor
Maxmudov Rafiq Amonovich
Buxoro Davlat Texnika Universiteti, professor.
Tilloyev Lochin Ismatilloyevich
Buxoro Davlat Texnika Universiteti, dotsent.
Raxmonov Qahramon Sanakulovich
Buxoro Davlat Texnika Universiteti, dotsent.
Barakayev Nusratullo Rajabovich
Islom Karimov nomidagi Toshkent Davlat Texnika Universiteti, professor.
Jo‘rayev Xayrullo Fayziyevich
Buxoro Davlat Texnika Universiteti, professor.
Panoyev Erali Rajabboyevich
Buxoro Davlat Texnika Universiteti, dotsent.
Ataullayev Sherzod Nabiullyevich
Buxoro Davlat Texnika Universiteti, dotsent.
Murodov Malik Negmurodovich
Buxoro Davlat Texnika Universiteti, dotsent.
Axmedova Ozoda Bahronovna
Islom Karimov nomidagi Toshkent Davlat Texnika Universiteti.
Safarov Bahri Jumayevich
Buxoro Davlat Texnika Universiteti, dotsent.
Xaydarov Axtam Amonovich
Buxoro Davlat Texnika Universiteti, dotsent.
Safarov Jasur Alijon o‘g‘li
Buxoro Davlat Texnika Universiteti, dotsent.
Асадова Раъно Дилмуратовна
Тошкент Давлат техника университети доценти

KIMYO FANLARI/ CHEMICAL SCIENCES/ ХИМИЧЕСКИЕ НАУКИ

Axmedov Voxid Nizomovich
Buxoro Davlat Texnika Universiteti, professor
Umarov Baqo Bafoyevich
Buxoro Davlat Universiteti, professor
Kodirov Abduaxad Abduraximovich
Qarshi davlat Universiteti, professor
Qurbonov Mingniqul Jumagulovich
Qarshi davlat Universiteti, dotsent
Turemuratov Sharibay Naurizbaevich
O‘zbekiston Respublikasi Fanlar akademiyasi Qoraqalpog‘iston bo‘limi Bosh ilmiy kotibi, professor
Tursunov Kaxor Shonazarovich
Qarshi davlat Universiteti, professor
Do‘stov Hamro
Buxoro Davlat Texnika Universiteti, professor
Panoyev Nodir Shavkatovich
Buxoro Davlat Texnika Universiteti, dotsent.
Olimov Bobur Bahodir o‘g‘li
Buxoro Davlat Texnika Universiteti, dotsent.
Kasimov Sherzod Abduazimovich
Termiz Davlat Universiteti, professor.
Aliqulov Rustam Valiyevich
Termiz Davlat Universiteti, professor
Tropov Xamza Tursunovich
Samarqand Davlat Universiteti, professor

IQTISODIYOT FANLARI/ ECONOMICS/ ЭКОНОМИЧЕСКИЕ НАУКИ

Nizamov Aslitdin Badreddinovich
Buxoro Davlat Texnika Universiteti, professor.
Boboyev Akmal Choriyevich
Buxoro Davlat Texnika Universiteti, professor.
Ergashxojayeva Shaxnoza Djasurovna
Toshkent davlat iqtisodiyot universiteti, professor
Saidaxmedova Nodira Ilxomovna
Toshkent davlat iqtisodiyot universiteti, professor
Muxsinov Bekzod Toxirovich
Buxoro Davlat Texnika Universiteti, dotsent.
Shakarov Qulmat Ashirovich
Renessans ta'lim universiteti,dotsent.
Jumaeva Zulfiya Qayumovna
Buxoro Davlat Texnika Universiteti, dotsent.
Norova Salomat Yusupovna
Buxoro Davlat Texnika Universiteti, dotsent.
Avezova Shaxnoza Maxmudjonovna
Buxoro Davlat Texnika Universiteti, dotsent.
Jalilov Jamshid G‘anijonovich
Toshkent davlat iqtisodiyot universiteti, dotsent
Xasanova Gulruh Djumanazarovna
Buxoro Davlat Texnika Universiteti, dotsent.

PEDAGOGIKA FANLARI/ PEDAGOGICAL SCIENCES / ПЕДАГОГИЧЕСКИЕ НАУКИ

Siddiqova Sadoqat G‘afforovna
Buxoro Davlat Texnika Universiteti, dotsent.
Zoyirov Erkin Xalilovich
Buxoro Davlat Texnika Universiteti, DSc, professor
Gaffarov Feruz Hasanovich
Puchon Universiteti, *professor*
Ruziyev Davron Yuldashevich
Buxoro Davlat Universiteti, professor
Muradova Firuza Rashidovna
Buxoro Davlat Texnika Universiteti, professor.
Yunusova Gulandon Samiyevna
Buxoro Davlat Texnika Universiteti, professor.
To‘xtayeva Zebo Sharifovna
Buxoro Davlat Texnika Universiteti, professor.
Navro‘zova Gulchixra Nigmatovna
Buxoro Davlat Texnika Universiteti, dotsent.
Uzoqova Laylo Polvonovna
Buxoro muhandislik – texnologiya instituti, dotsent.
To‘raqulova Marjona Qiyom qizi
Buxoro Davlat Texnika Universiteti, dotsent.
Muradova Zarina Rashidovna
Buxoro Davlat Texnika Universiteti, dotsent.
Murodov Sanjar Aslonovich
Buxoro Davlat Texnika Universiteti, dotsent.
Shodiyev Jahongir Jo‘raqulovich
Buxoro Davlat Texnika Universiteti, dotsent
Gaffarov Laziz Hasanovich
Buxoro muhandislik – texnologiya instituti, dotsent.

Tahririyat a’zolarning to‘liq ro‘yxati jurnalning www.devos.uz saytida keltirilgan.

Tahririyat hay’ati a’zolarining tarkibini o‘zgartirish hamda qo‘shimcha kiritish yoki tahririyat a’zoligidan chiqarish bosh muharrir tomonidan amalga oshiriladi.

ISSN 3030-3907

Development of science ilmiy jurnali 2024 yil 15 aprel kuni №256445 sonli guvohnoma bilan Davlat ro‘yxatidan o‘tgan.

To‘plam elektron ko‘rinishda (pdf formatida) mualliflarga taqdim etiladi. To‘plamga kiritiladigan maqolalarning mazmuni, ulardagi statistik ma’lumotlar va me’yoriy hujjatlarning to‘g‘riligiga hamda har qanday fikr - mulohazalarga mualliflarning o‘zlari mas’ul hisoblanadilar. Talablarga javob bermaydigan maqolalar to‘plamga kiritilmaydi. Tashkiliy qo‘mita maqola matnini qisqartirish, qisman tuzatish kiritish, seksiyalarga joylashtirish huquqiga ega.

ISSN 3030-3907

IMPROVING THE OUTPUT VOLTAGE QUALITY IN HYBRID POWER PLANTS USING AN INTEGRATED BATTERY AND SUPERCAPACITOR SYSTEM

K.Sh. Kadirov

Head of the Laboratory "Energy efficiency and energy saving systems", Institute of Energy Problems, Academy of sciences of the Republic of Uzbekistan.

E-mail: kamoliddin.8484@mail.ru

H.I. Ibragimova

Navoi State University of Mining and Technology, assistant of the department of "Electro energy".

E-mail: ikhusniya@list.ru

Annotation. This article examines improving the quality and stability of electrical energy in solar-diesel hybrid power plants through the use of an integrated hybrid energy storage system based on batteries and supercapacitors. The main challenges of hybrid power plants include rapid fluctuations in inverter output voltage, dynamic load changes, variability in renewable energy sources (solar radiation), and harmonic distortion caused by nonlinear loads. These factors lead to increased total harmonic distortion (THD), phase errors, and RMS voltage instability. These factors lead to malfunctions in consumer equipment, reduced energy efficiency, and increased diesel generator over-runs.

Keywords: EPS, energy transition, wind and solar generation, demand response, deficit modes, mode balancing, contractual relations, consumer-regulators.

Аннотация. Ushbu maqolada akkumulator batareyalari (AKB) va superkondensatorlarning integratsiyalashgan gibrid energiya saqlash tizimi asosida ishlovchi quyosh–dizel elektr stansiyalarida elektr energiyasi sifati va barqarorligini oshirishga qaratilgan. Gibrid elektr stansiyalarida asosiy muammo – invertor chiqishidagi kuchlanishning tez o‘zgarishi, yuklamaning dinamik tebranishlari, qayta tiklanuvchi manbalar (quyosh radiatsiyasi) o‘zgaruvchanligi, hamda nochiziqlik yuklamalar ta’sirida yuzaga keluvchi garmonik buzilishlardir. Bu omillar THD oshishi, fazaviy xatolar va o‘rtacha kvadrat kuchlanishning barqaror emasligiga olib keladi; natijada iste’molchilarning uskunalari ish rejimida uzilishlar, energiya samaradorligining pasayishi va dizel generatorning ortiqcha ishlash sikllariga sabab bo‘ladi

Kalit so'zlar: Smart grid tizimi, SCADA, oqilona energiya iste’moli, quyosh-dizel elektr stansiyasi, avtomatik tartibga solish, energiya manbalarini almashtirish, Arduino mikrokontroller, gibrid energetik tizim.

ISSN 3030-3907

Аннотация. В данной статье рассматривается повышение качества и стабильности электрической энергии в солнечно-дизельных гибридных электростанциях за счёт применения интегрированной гибридной системы хранения энергии на основе аккумуляторных батарей (АКБ) и суперконденсаторов. Основной проблемой гибридных электростанций являются быстрые колебания выходного напряжения инвертора, динамические изменения нагрузки, вариативность возобновляемых источников энергии (солнечной радиации), а также гармонические искажения, возникающие под воздействием нелинейных нагрузок. Эти факторы приводят к увеличению коэффициента гармонических искажений (THD), фазовым ошибкам и нестабильности среднеквадратичного значения напряжения; в результате возникают сбои в работе потребительского оборудования, снижается энергетическая эффективность и увеличивается число избыточных рабочих циклов дизель-генератора.

Ключевые слова: Ситема smart grid,SCADA, рациональное энергопотребление, солнечно-дизельная электростанция, автоматическое регулирование, переключение источников энергии, микроконтроллер Arduino, гибридная энергосистема.

INTRODUCTION.

In the modern world, electricity is one of the most essential resources, supporting every sphere of human activity. Like any other commodity, electricity is subject to quality requirements. However, it has unique characteristics: its parameters can vary over time, and in case of complaints, it cannot be returned or exchanged. Furthermore, the quality of electricity may depend on the requirements of the specific consumer [1].

The main goal of the concept is to meet the growing demand for electricity at competitive prices and to ensure the dynamic development of the country's power sector through the modernization and reconstruction of existing power plants, the construction of new generation facilities based on high-efficiency technologies, the improvement of electricity metering systems, and the diversification of fuel and energy resources, including the development of renewable energy sources (RES).

In most developed countries around the world, renewable energy sources are increasingly being used for electricity generation, with their share exceeding 20% in some countries. In this context, the study of power quality parameters and dynamic characteristics of operating modes of photovoltaic power plants (PVPPs), when operating in parallel with traditional power systems, is highly relevant.

ISSN 3030-3907

To achieve a reliable control system for the entire electricity generation process, it is essential to integrate all components responsible for energy production, transmission, and distribution into a unified system - up to the end consumers. Such integration is necessary to ensure data synchronization and thorough analysis of all possible processes. This requirement is addressed by the concept of Smart Grids.

The essence of a Smart Grid lies not only in the delivery of electricity to various categories of consumers but also in data collection. Based on the collected data, the system allows for real-time tariff accounting, forecasting, and planning of electricity consumption and generation [2]. The intelligent control system also facilitates the integration of traditional energy sources with non-traditional renewable energy sources. This includes the hybrid operation of thermal power plants (TPPs), hydroelectric power plants (HPPs), nuclear power plants (NPPs), and diesel power plants (DPPs) with solar power plants (PVPPs), wind power plants (WPPs), and other renewable energy sources (RES) [3].

METHODS AND MATERIALS

In the context of the global transition to sustainable energy sources, the integration of solar-diesel hybrid systems (SDHPPs) into smart grids is becoming increasingly important. The combination of photovoltaics, diesel generators, and energy storage systems ensures energy supply reliability and flexibility in remote and unstable regions. A Smart Grid is an intelligent energy infrastructure that provides two-way communication between energy producers and consumers. The implementation of SDHPPs into such systems not only decentralizes power generation but also enables adaptive resource management. Hybrid solar-diesel power plants represent an increasingly viable solution for ensuring reliable electricity supply in remote or off-grid areas. By integrating photovoltaic (PV) systems with conventional diesel generators, these plants leverage the advantages of both renewable and traditional energy sources. This combination enables consistent power generation while reducing fuel consumption, operational costs, and greenhouse gas emissions.

In typical operation, solar energy is prioritized during daylight hours, powering the load directly and, when integrated with battery storage systems, charging them for later use. When solar irradiance is insufficient—due to weather conditions or during nighttime—the diesel generator compensates for the shortfall, ensuring uninterrupted energy supply. The use of advanced energy management systems allows for the intelligent coordination of energy flows between the solar PV array, diesel generator, storage systems, and the load. These systems monitor

ISSN 3030-3907

energy production and consumption in real time, optimizing the plant's efficiency and minimizing the runtime of diesel generators [3].

Structure of a Solar-Diesel Hybrid System

- a typical sdhpp includes;
- photovoltaic panels (pv);
- diesel generator;
- energy storage system (batteries and/or supercapacitors);
- inverter and controller;
- scada system for monitoring and control.

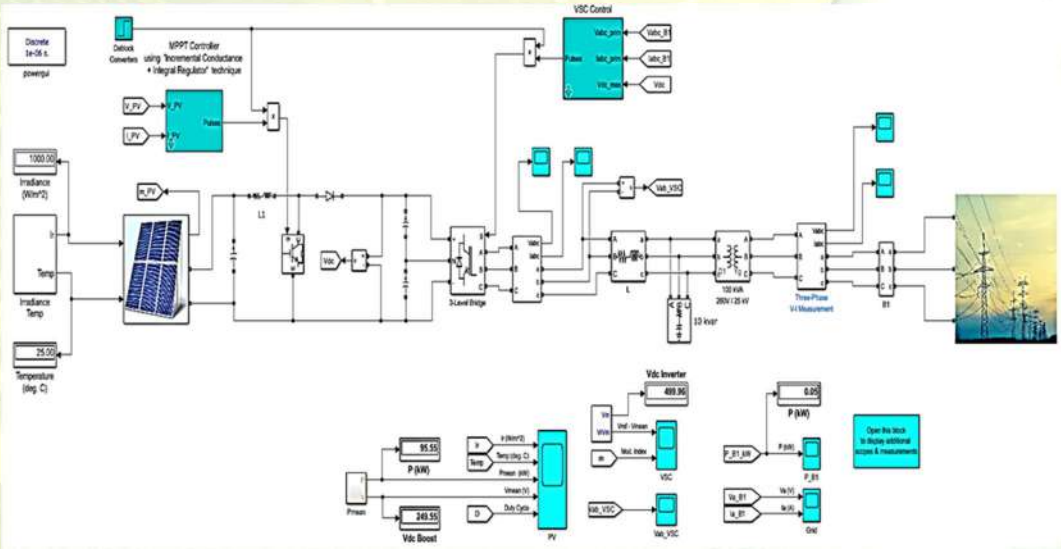


Fig.1 A simulation model of the inverter device of a solar-diesel power plant assembled in the Matlab/Simulink software package

The energy balance can be described by the equation:

$$P_{load}(t) = P_{PV}(t) + P_{DG}(t) + P_{bat}(t) \pm \Delta P(t) \quad (1)$$

where $P_{load}(t)$ is the load at time t, $P_{PV}(t)$ is the power from the solar plant, $P_{DG}(t)$ is the power from the diesel generator, $P_{bat}(t)$ is the power from the battery, and $\Delta P(t)$ represents energy losses.

Reduction of harmonic effects between inverter and diesel generator.

$$V_{sys}(t) = V_{PV}(t) + V_{DG}(t) - \Delta V_{loss}(t) \quad (2)$$

The output signal of the automatic regulator for voltage stabilization is determined according to the following law:

$$U_{ctrl}(t) = K_p \cdot e(t) + K_i \int e(t)dt + K_d \frac{de(t)}{dt} \quad (3)$$

where: $e(t) = V_{ref} - V_{sys}(t)$- error, $K_p K_i K_d$- proportional, integral and differential coefficients of the controller.

Integrating SDHPPs into the Smart Grid requires:

- Frequency and voltage synchronization with the grid;
- Implementation of intelligent control (e.g., predictive regulation);

ISSN 3030-3907

− Capability to store and inject energy into the grid.

Example of Energy Flow Control Algorithm

The control algorithm can be implemented as follows:

Monitor parameters: P_{PV}, P_{load}, SOC

If $P_{PV} > P_{load}$, the excess goes to charge the battery

If $P_{PV} + P_{bat} < P_{load}$, the diesel generator is started

If SOC is low, the system switches to economy mode

Control law (for automatic voltage adjustment):

$$U_{ref} = U_0 + k_p(P_{set} - P_{meas}) + k_1 \int (P_{set} - P_{meas})dt \quad (4)$$

Through this formula, voltage is automatically corrected for power deviations.

Generation suitable for covering peak loads should have other "useful" properties: be dispatched, that is, controlled by a person;

− to be as maneuverable as possible, that is, capable of delivering energy to the network in minutes, and sometimes even seconds, and not fail with an equally rapid shutdown;

− have minimal capital costs.

While intermittent alternative generation is a fraction of a percent of the dispatched generation, its saw is simply lost in the general "noise". This does not mean that the harm from intermittent alternative generation is absent at its small fraction, it means that the harm is so small that it can be neglected, but only in this case, any possible "help" from intermittent alternative generation is also so small that it can also be neglected.

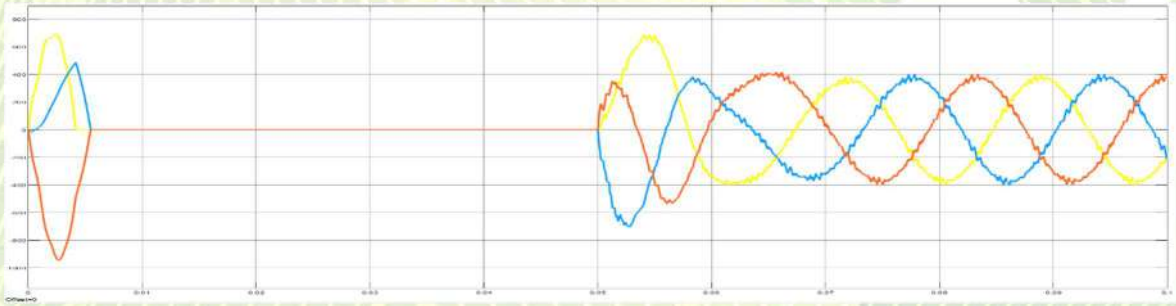


Fig.3 Parameters of the simulation model of the inverter device of a solar-diesel power plant assembled in the Matlab/Simulink software package

There are a number of methods that can be used to solve intermittent alternate generation problems, i.e. methods of balancing an emerging production saw: overproduction of alternative energy; expansion of networks; demand management; energy storage; duplication of traditional generating energy.

Results and discussion

To evaluate the efficiency of different operating modes of a Solar-Diesel Hybrid Power Plant (SDHPP), a comparative analysis was conducted for four

ISSN 3030-3907

configurations: diesel-only mode, solar-diesel mode, SDHPP with battery storage, and SDHPP with both battery and supercapacitor.

Table 1.

Comparison of SDES operating modes

Mode	Fuel Consumption (L/day)	Diesel Operation Time (h/day)	Battery Wear (%)
Diesel Only	40	24	0
Solar-Diesel	20	12	5
SDHPP with Battery	10	6	10
SDHPP with Battery and Supercapacitor	6	4	3

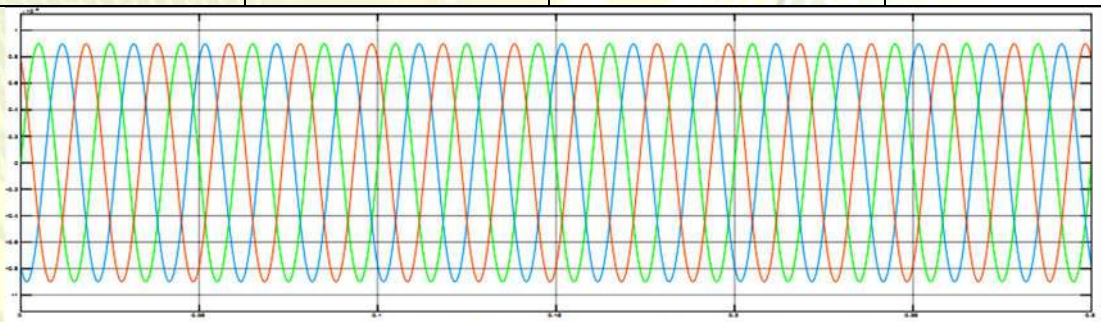


Fig.4 Graph comparing different operating modes of a solar-diesel hybrid power plant (SDHPP) on three parameters: fuel consumption (l/day), diesel runtime (hrs/day) ,battery wear (%)

Fuel Efficiency: The best performance is shown by the system with both a battery and a supercapacitor, reducing fuel consumption by 85% compared to the diesel-only mode.

1. Diesel Generator Runtime: Significantly reduced operation time extends the equipment's service life and lowers maintenance costs.

2. Battery Longevity: Integrating a supercapacitor reduces the load on the battery, minimizing degradation and increasing its lifespan.

3. Thus, the most efficient and reliable configuration is the combined use of batteries and supercapacitors, which ensures high energy efficiency and stable power supply performance.

In this table, a comparative analysis of the basic indicators of the hybrid system with integrated AKB and supercapacitors is introduced.

ISSN 3030-3907

Table 2.

Comparative analysis of controllers without filtration and use of AKB and supercapacitors

Indicator	Without Monitoring	With Monitoring	Percentage Change
Downtime	4,2 h/m	1,3 h/m	↓ 69%
Response time	90 c	25 c	↓ 72%
Energy efficiency	83 %	92 %	↑ 9%

CONCLUSION

Hybrid solar-diesel power plants offer a practical and effective approach to addressing the challenges of energy access, fuel dependency, and environmental sustainability in off-grid locations. By combining the strengths of solar power and diesel generation, these systems ensure a reliable power supply while minimizing environmental and economic costs. With ongoing advancements in technology and decreasing costs of solar components, hybrid energy systems are poised to play a key role in the future of decentralized and sustainable energy infrastructure. Analysis of information on this topic showed that there are a number of requirements for the quality of electrical energy, which are determined by the increasingly high level of use of high-tech industries in various sectors of agriculture. This is especially important for alternative generation at wind turbines, biogas stations (internal combustion engine generation) and solar power plants. There are a number of ways to improve the quality of electricity to increase the efficiency of energy supply to consumers, such as reactive power compensation devices, synchronous compensators, inverter devices, etc. It should be noted that the use of these devices is individual in each case and the choice should be made on the basis of a feasibility study. The main indicators of power quality are parameters such as voltage, frequency and harmonic distortion.

REFERENCES

1. Ibragimova X.I., Baranova M.P. Прогнозируемые энергетические характеристики фотоэлектрических преобразователей в автономных системах электроснабжения при помощи инверторного блока. (2024), Journal of Advances in Engineering Technology Vol.1(13), 2024 January-March, 2024.

2. Bhattacharyya, S. C. (2013). *Rural electrification through decentralized off-grid systems in developing countries*. Springer. https://doi.org/10.1007/978-1-4471-5016-1

ISSN 3030-3907

3. International Renewable Energy Agency (IRENA). (2015). *Renewable power generation costs in 2014*. International Renewable Energy Agency. Retrieved from https://www.irena.org/publications.
4. Dursun, B., & Alboyaci, B. (2010). Determination of the optimum hybrid renewable power generating systems for selected locations in Turkey. *Renewable and Sustainable Energy Reviews, 14*(5), 1402–1410. https://doi.org/10.1016/j.rser.2009.11.006
5. Rehman, S., Bader, M. A., & Al-Moallem, S. A. (2007). Cost of solar energy generated using PV panels. *Renewable and Sustainable Energy Reviews, 11*(8), 1843–1857. https://doi.org/10.1016/j.rser.2006.03.005
6. Gupta, A., & Saini, R. P. (2020). Modeling of hybrid energy system—Part I: Problem formulation and model development. *Renewable Energy, 145*, 297–311. https://doi.org/10.1016/j.renene.2019.05.073
7. International Energy Agency (IEA). (2022). *World Energy Outlook 2022*. Retrieved from https://www.iea.org/reports/world-energy-outlook-2022
8. Lahmeyer International. (2016). *Hybrid power generation systems – A technology review*. Deutsche Gesellschaft für Internationale Zusammenarbeit (GIZ) GmbH.
9. Liserre, M., Timbus, A. V., & Piegari, L. (2008). *Power quality improvement in hybrid systems combining wind power and diesel generators*. *IEEE Transactions on Industrial Applications, 44*(4), 1391–1399. https://doi.org/10.1109/TIA.2008.924045
10. Bobur Narzullayev; Javokhir Boboqulov, Improving reliability based on diagnostics of the technical condition of electric motor stator gutters, AIP Conf. Proc. **3331**, 030032 (2025). https://doi.org/10.1063/5.0305735
11. Turdibekov K. et al. Experimental and statistical methods for studying the modes of electric power systems under conditions of uncertainty //E3S Web of Conferences. – EDP Sciences, 2023. – T. 452. – C. 04002. https://doi.org/10.1051/e3sconf/202345204002
12. Tursunova A. et al. Researching localization of vertical axis wind generators //E3S Web of Conferences. – EDP Sciences, 2023. – T. 417. – C. 03005. https://doi.org/10.1051/e3sconf/202341703005
13. Boboqulov J., Narzullayev B. Development of a model for diagnosing rotor conditions in the parallel connection of synchronous generators with the network // E3S Web of Conferences. – EDP Sciences, 2024. – T. 525. – C. 06001. https://doi.org/10.1051/e3sconf/202452506001
14. Amirov S.F., Ataullayev N.O., Ataullayev A.O., Muxammadov A.O., Majidov B.Q., A.U. Methods for reducing the temperature components of

ISSN 3030-3907

magnetomodulation DC converter errors. *E3S Web of Conferences*, **417**, 03011 (2023). https://doi.org/10.1051/e3sconf/202341703011

15. Amirov S.F., Ataullayev A.O., Sayidov M.K., Togayev I.B. Methods of reduction of interference signals in electromagnetic conductors that measure fluid flow Journal of Physics: Conference Series, 2094(5), 052053 (2021) 10.1088/1742-6596/2094/5/052053

16. Bakhodir Ramazonov, Shakhzodbek Sayfiev, Khasan Muradov, Mathematical modeling and research of high capacity lead-acid stabilized accumulator battery, AIP Conf. Proc. **3268,** 020043 (2025) https://doi.org/10.1063/5.0257860

17. Khasan Murodov, Askarbek Karshibayev, and Shukhrat Abdullayev, Analysis of the process of balanced charging of the battery group with high capacity, E3S Web of Conferences **548**, 03012 (2024) https://doi.org/10.1051/e3sconf/202454803012

18. Muzaffar Xolmurodov., Shaxzod Hakimov., Umida Oripova, Improving energy efficiency in public buildings: Modern technologies and methods, AIP Conf. Proc. **3331,** 040060 (2025) https://doi.org/10.1063/5.0306935

ISSN 3030-3907